


Temperaturdiagramm Primärnetz

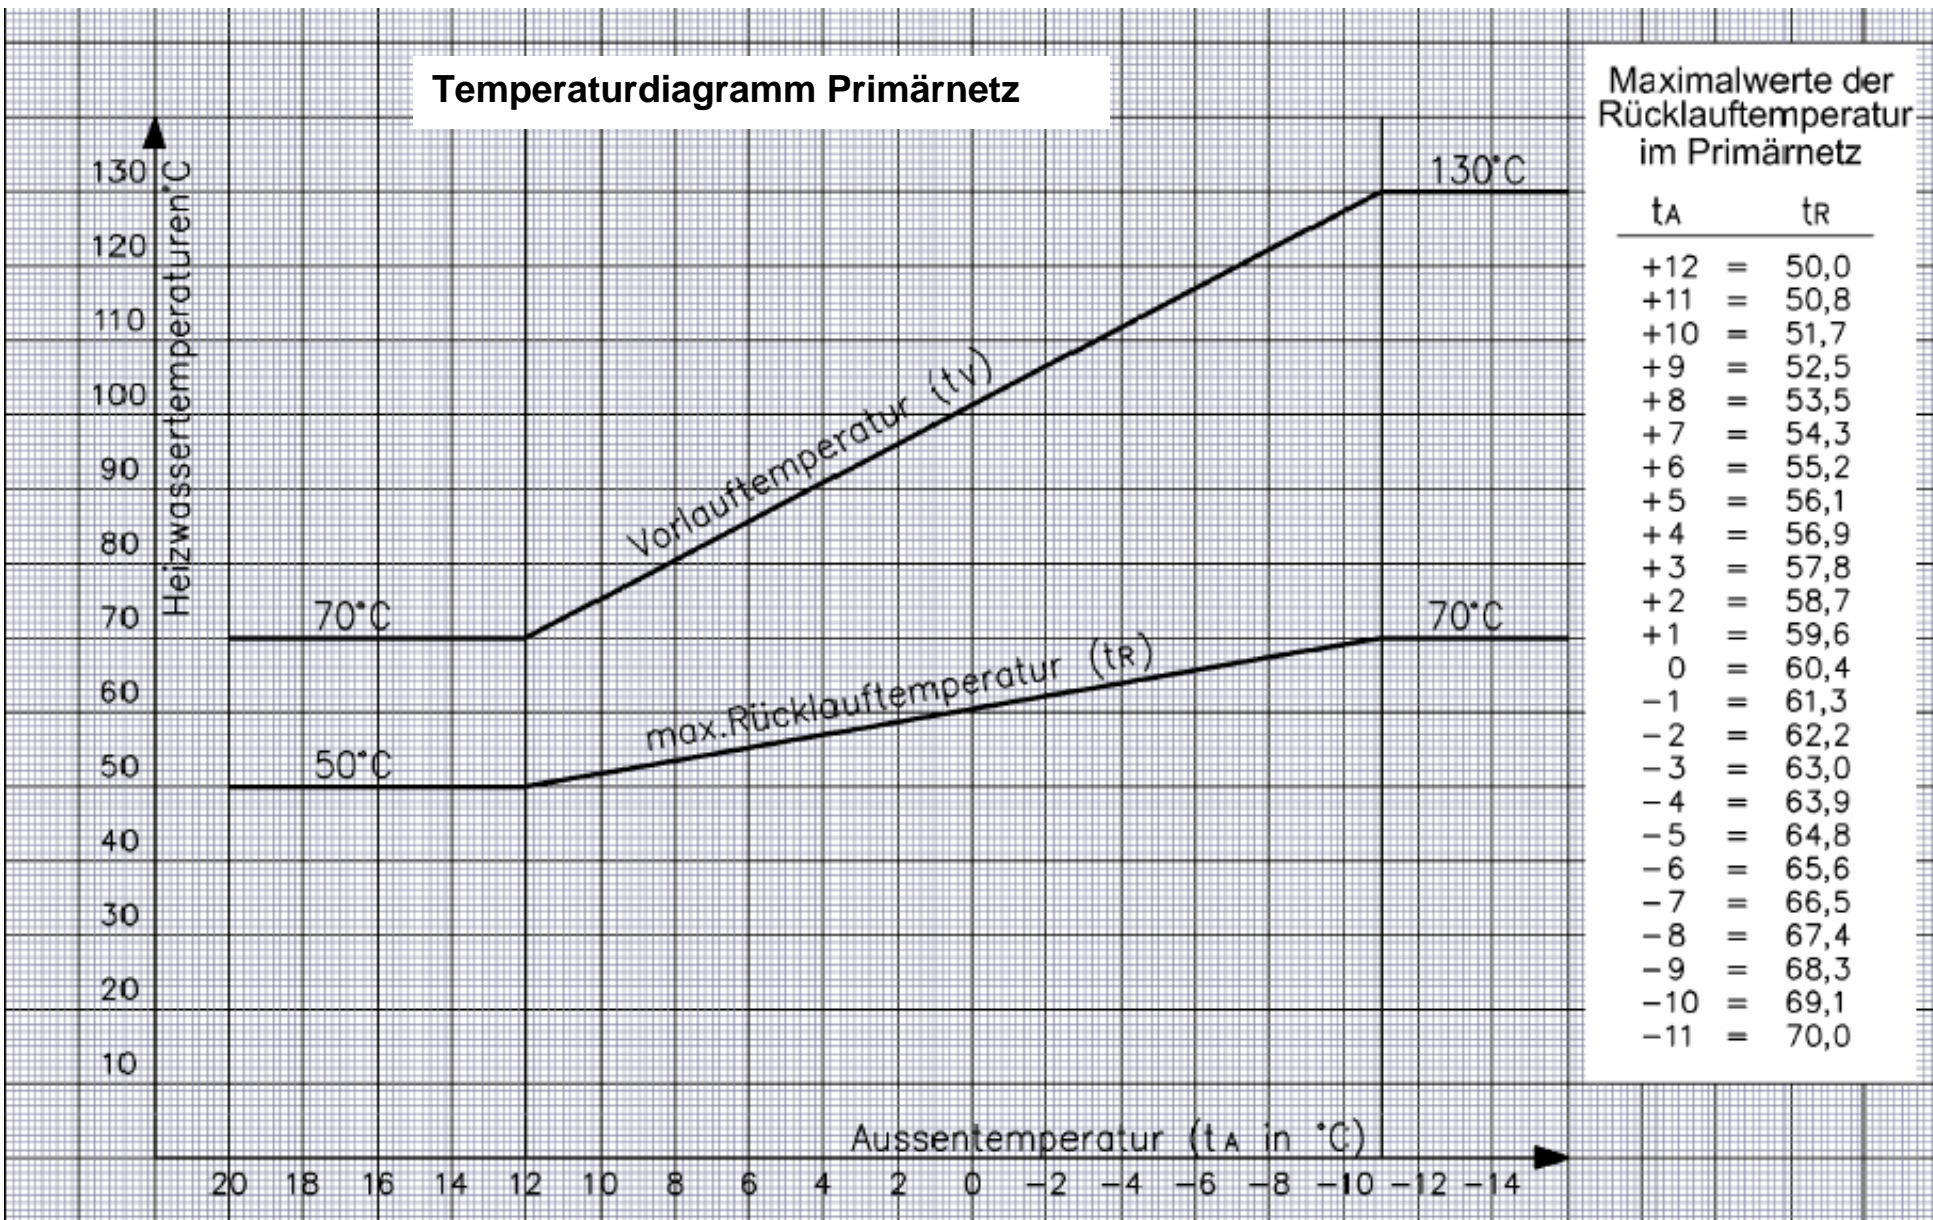

Maximalwerte der Rücklauftemperatur im Primärnetz

t_A	t_R
+12	= 50,0
+11	= 50,8
+10	= 51,7
+9	= 52,5
+8	= 53,5
+7	= 54,3
+6	= 55,2
+5	= 56,1
+4	= 56,9
+3	= 57,8
+2	= 58,7
+1	= 59,6
0	= 60,4
-1	= 61,3
-2	= 62,2
-3	= 63,0
-4	= 63,9
-5	= 64,8
-6	= 65,6
-7	= 66,5
-8	= 67,4
-9	= 68,3
-10	= 69,1
-11	= 70,0